





Spare Parts / Ersatzteile / Pièces de recharge / Pezzi di Ricambio / Piezas de requesto /  
 Parte de reposição / Reserveonderdelen / Reservdelar / Reservedeler / Varaosat /  
 Vraosat / Varahlutir / Ανταλλακτικά / Yedek Parçalar / Náhradní díly / Náhradné diely /  
 Nadomestni deli / Резервни части / Запчасти / Części Zapasowe / Piese de schimb  
 / Rendelhető alkatrészek / Запасні частини / Reservni delovi / Резервни делови /  
 Резервни делови / Atsarginių dalių / Tellitavad varuosad / Rezervju daļu

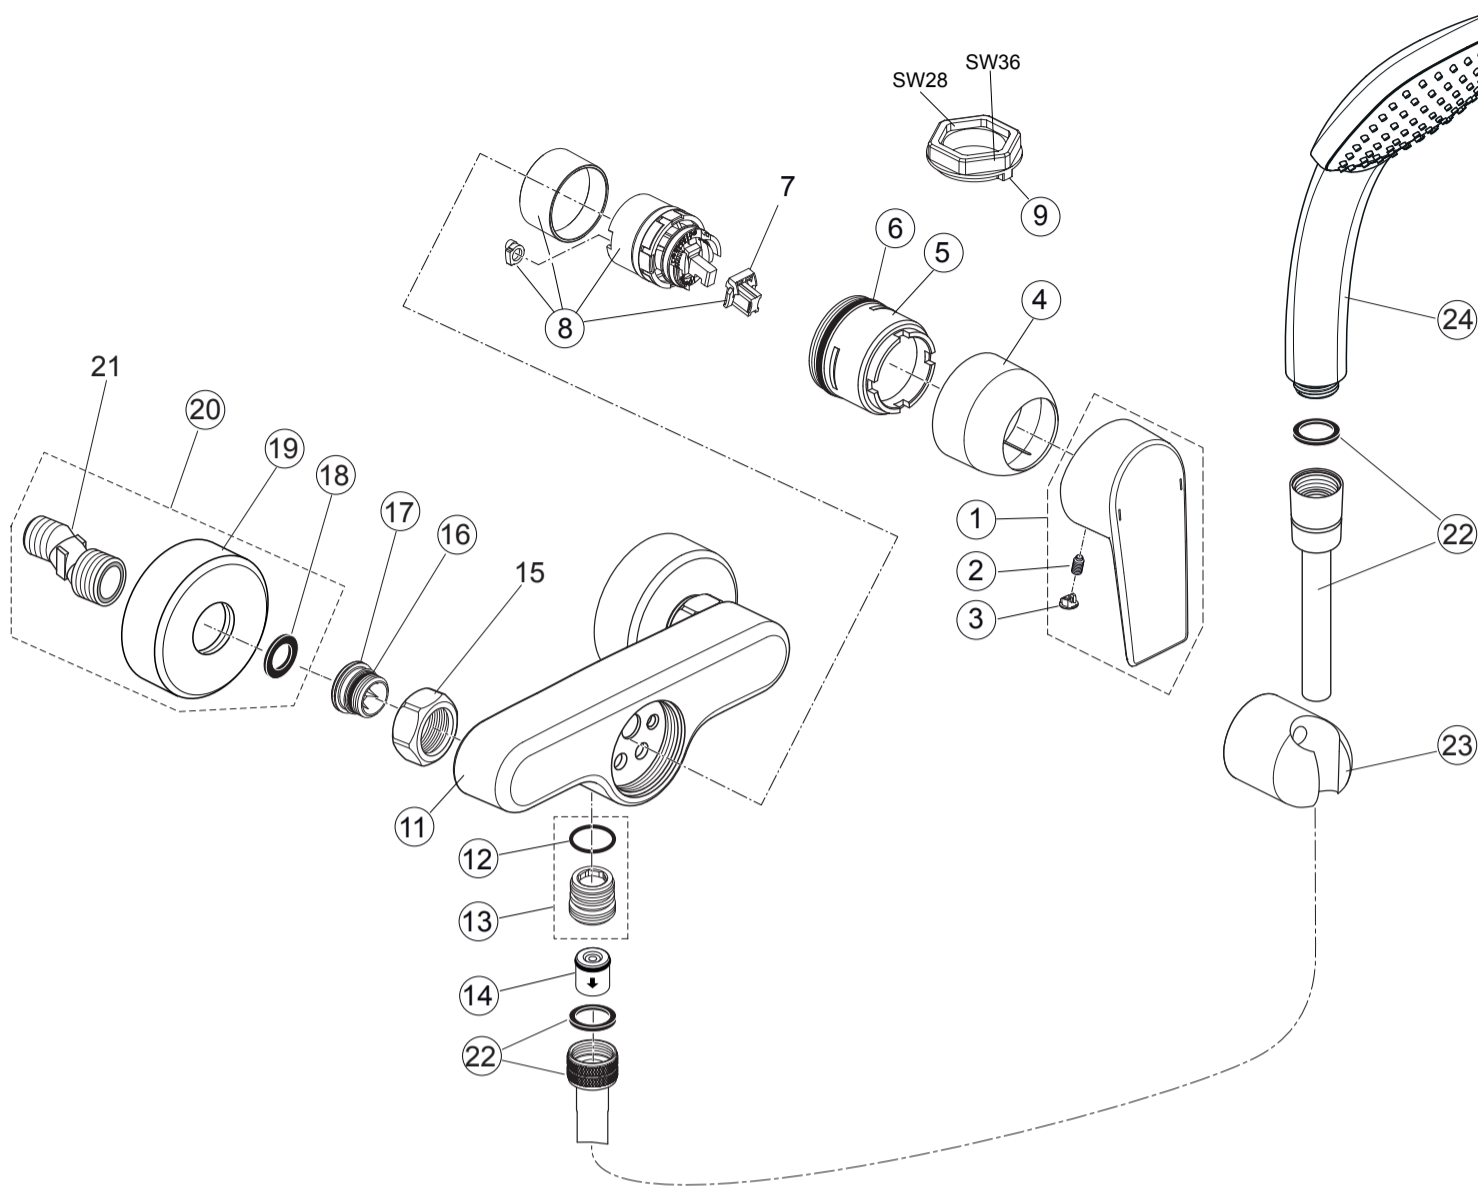


1	A 861 019 AA	1 Set
2	A 963 309 NU	1 pcs
3	B 960 473 AA	1 pcs
4	B 960 779 AA	1 Set
5	B 960 780 NU	1 Set
6	A 961 863 NU	1 pcs
8	A 861 156 NU	1 Set
9	B 960 650 NU	1 pcs
12	A 961 810 NU	2 pcs
13	A 963 651 NU	1 Set
14	A 962 594 NU	2 pcs
16	A 961 182 NU	1 pcs
18	A 963 909 NU	2 pcs
19	B 960 242 AA	1 pcs
20	A 961 073 AA	2 pcs
22	F 960 697 AA	1 pcs
23	B 960 096 AA	1 pcs
24	B 0002 AA	1 pcs

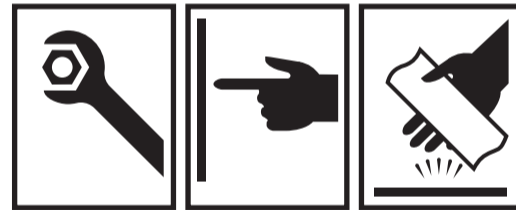


## Tesi

A 6581 .. A 6582 ..


0120 / A 868 158

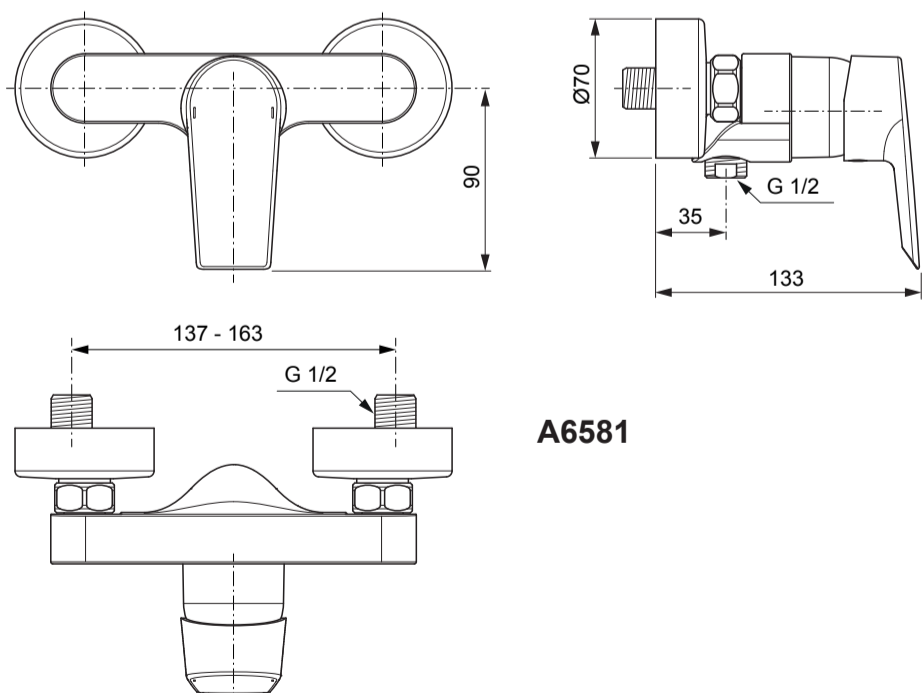

**A6581**

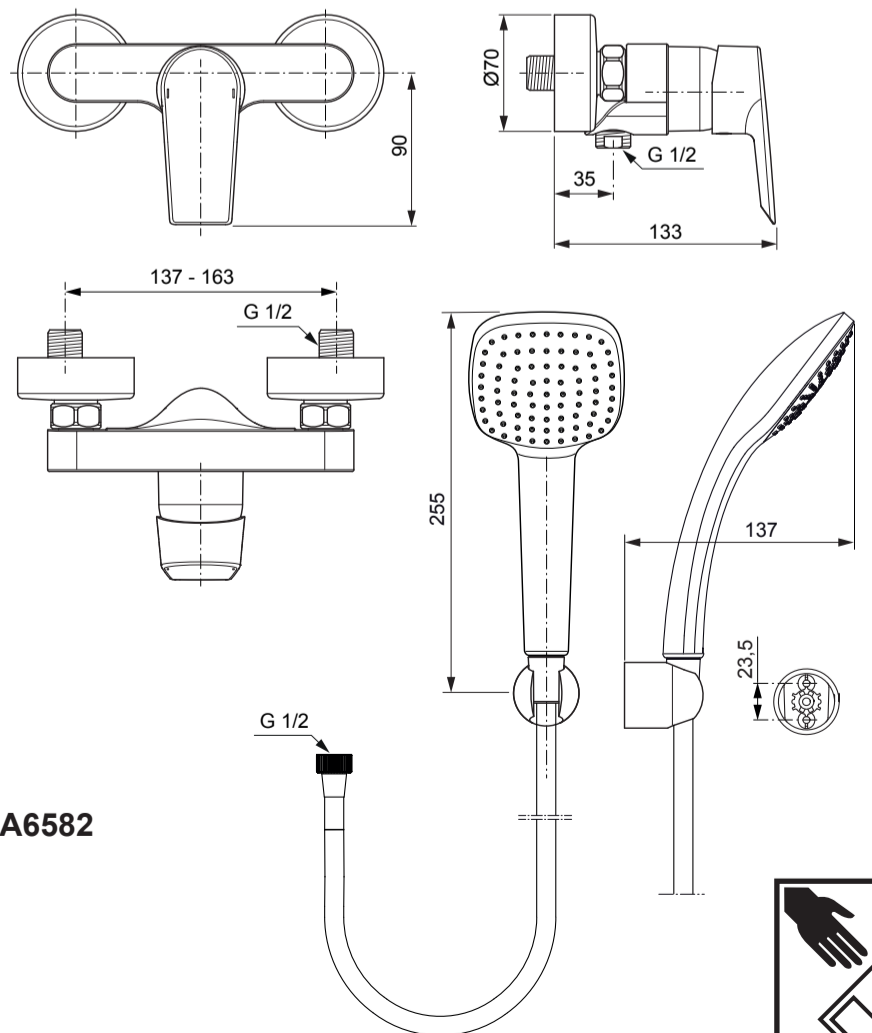






**A6582**

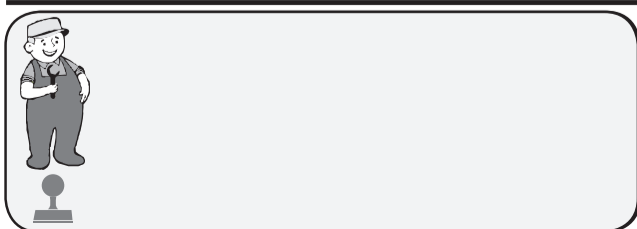

Ideal Standard International NV  
 Corporate Village - Gent Building  
 Da Vincilaan 2  
 1935 Zaventem  
 Belgium

www.idealstandardinternational.com



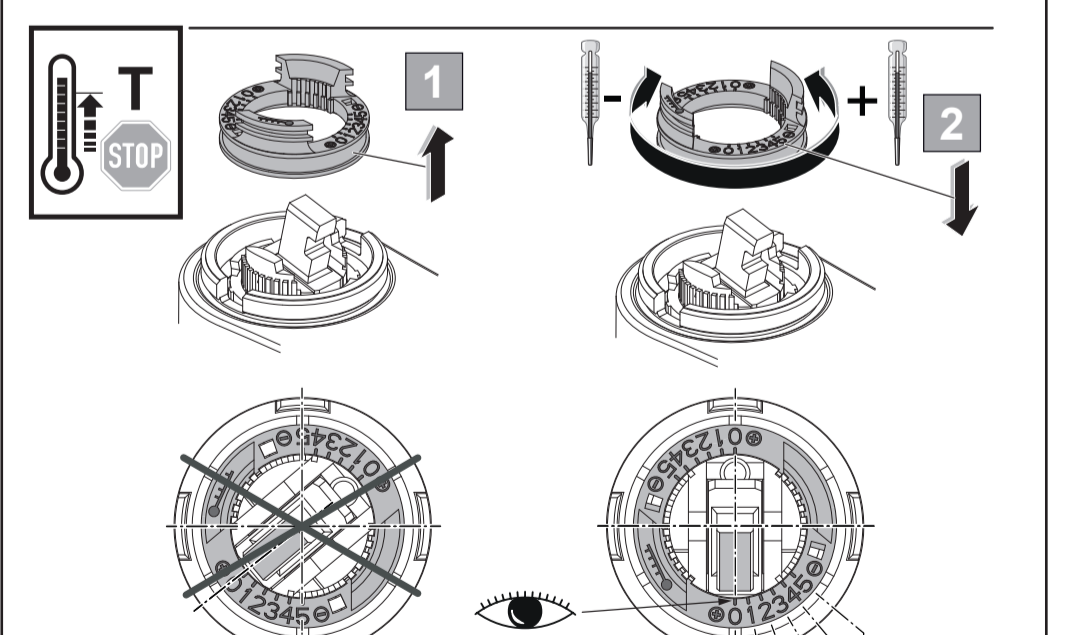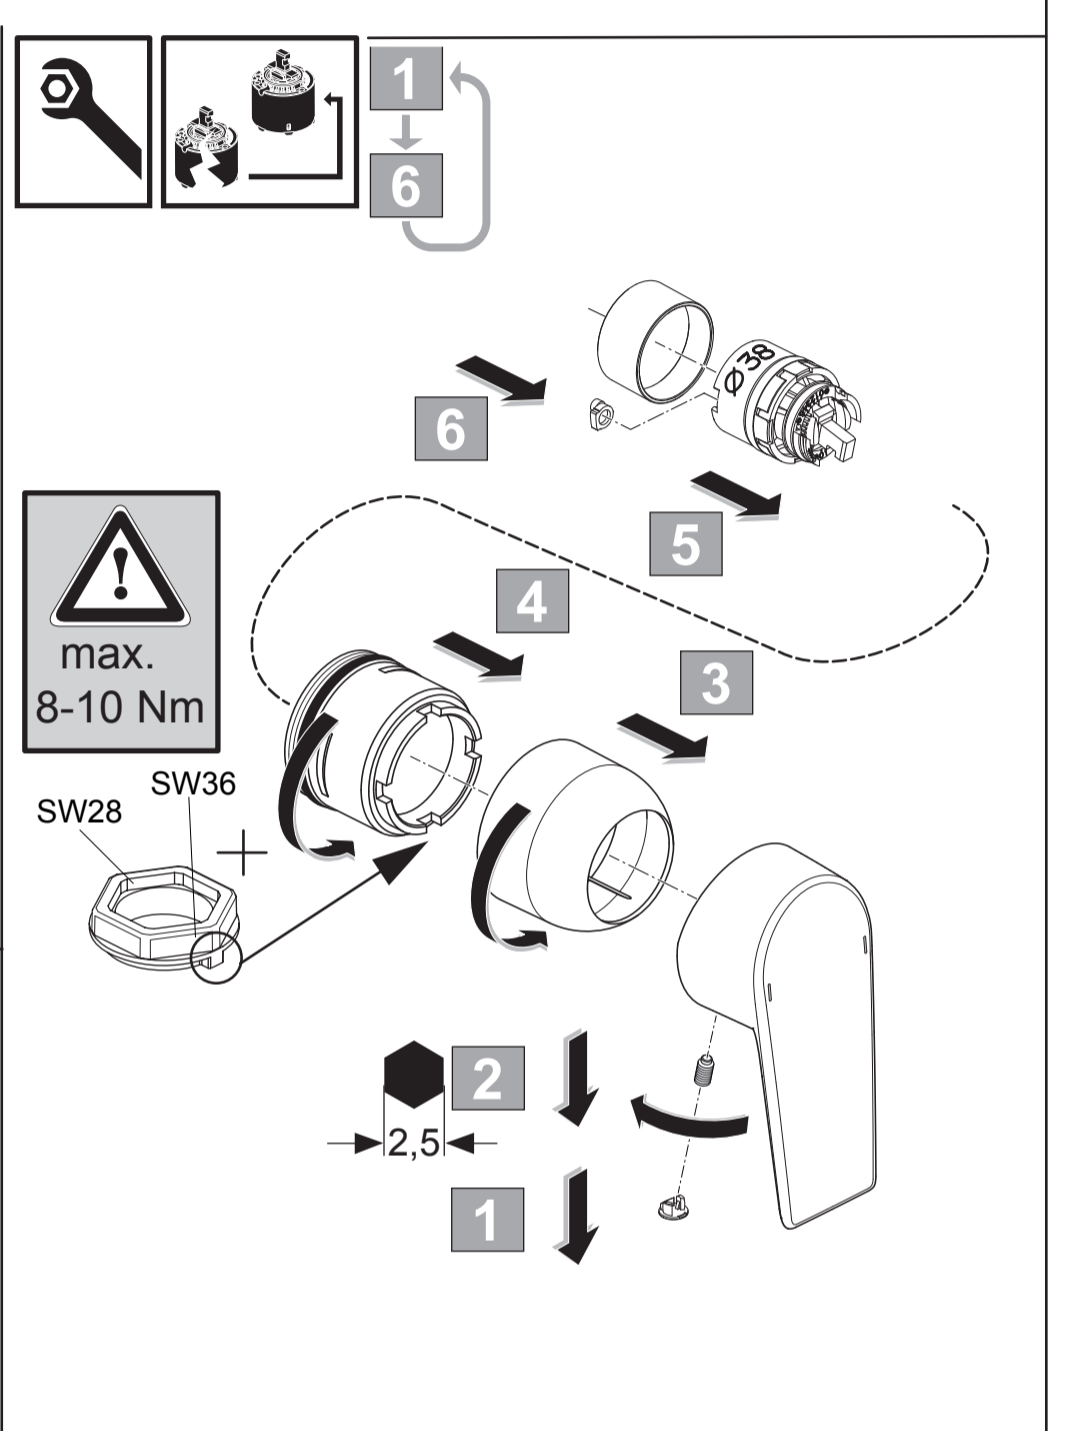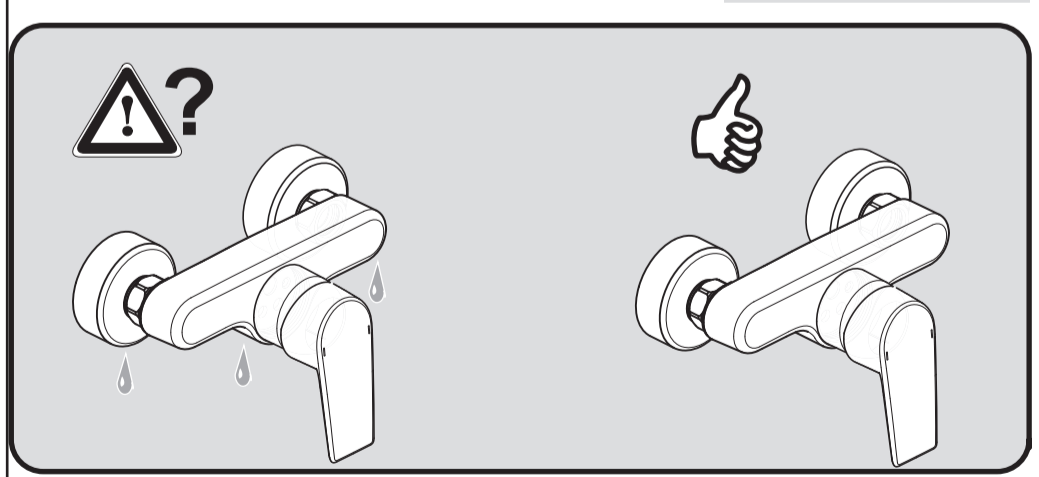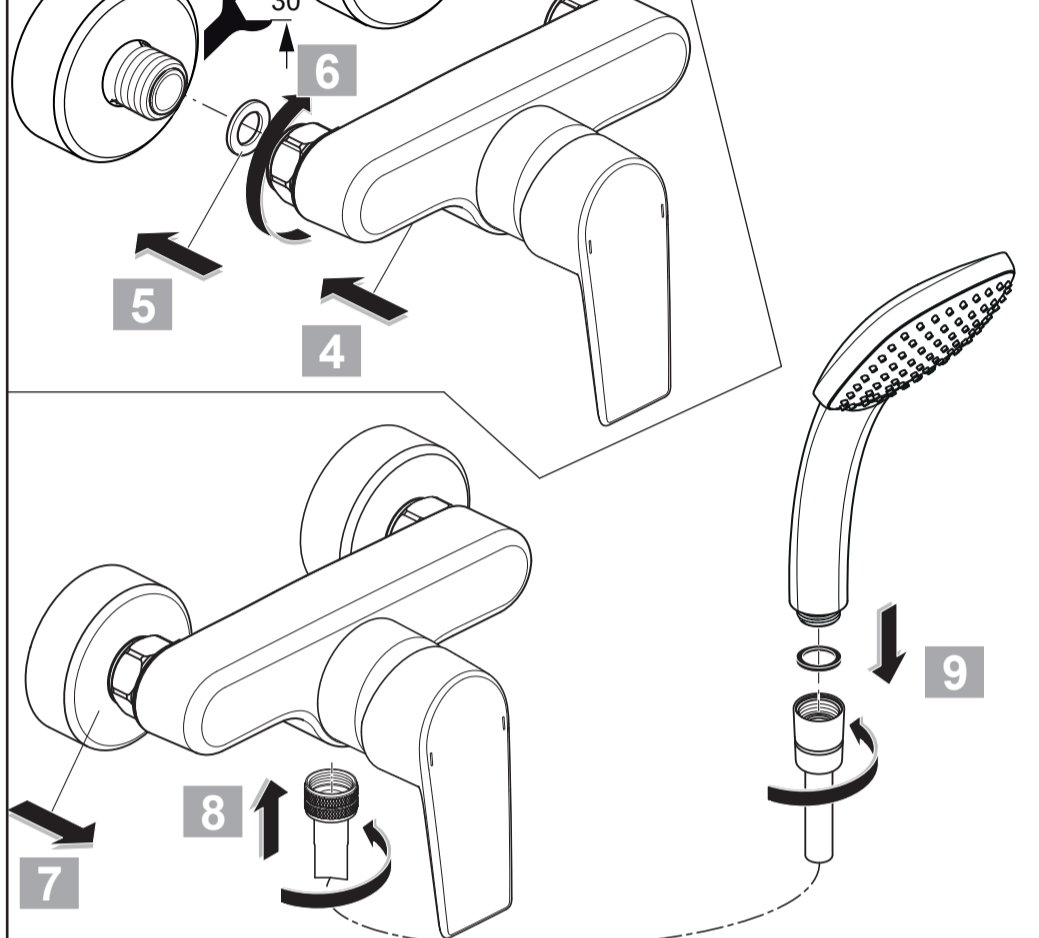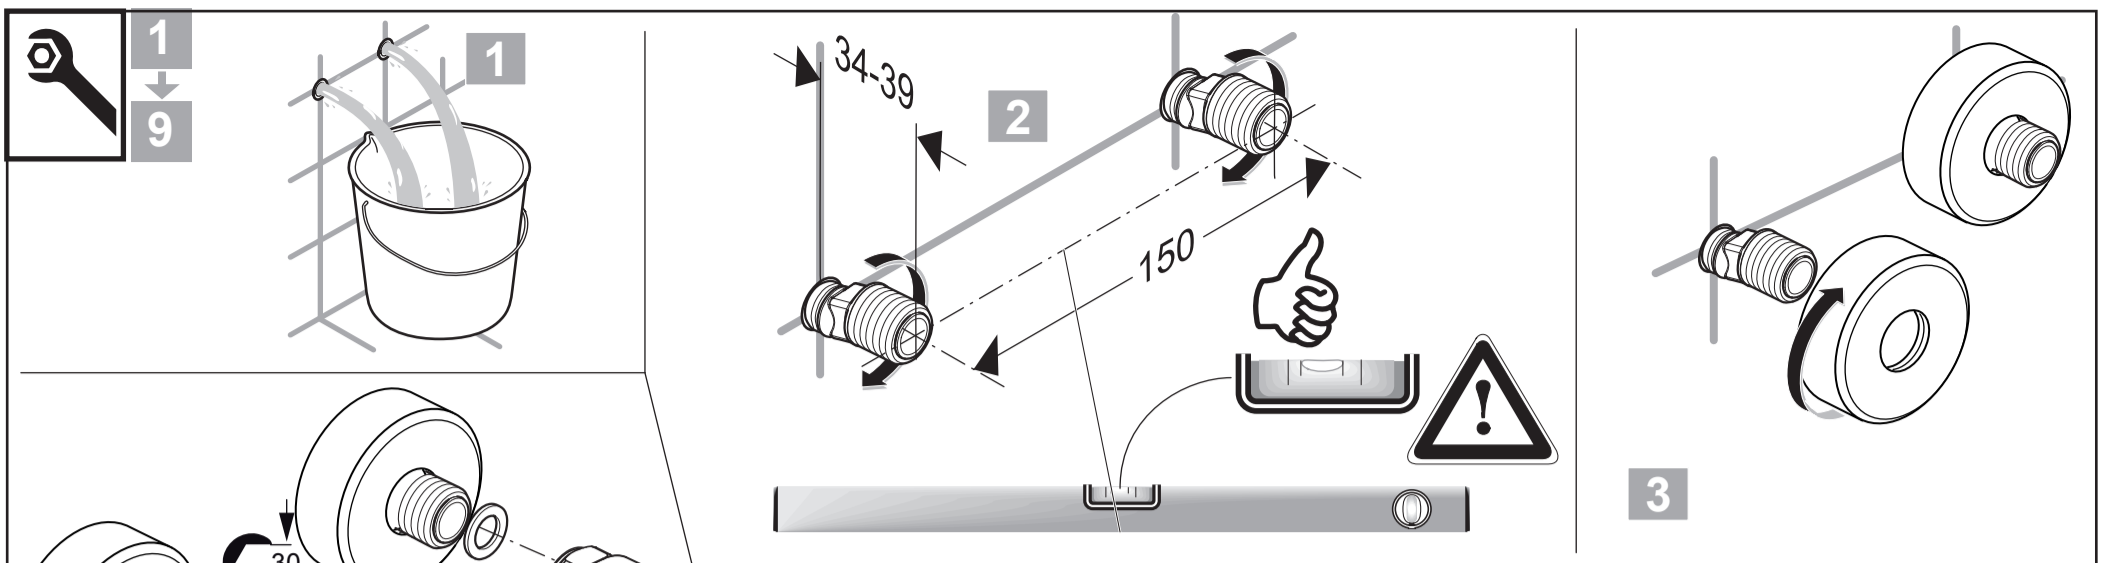

	<b>P</b>	bar		MAX. 10		5		<b>Q</b>	(3 bar)
	<b>T</b>	°C		MAX. 80		65			
						55		8	22

			0	1	2	3	4	5
<b>P</b>	°C	°C	°C	°C	°C	°C	°C	°C
0,3 MPa	50°C	15°C	50	49	44	40	35	33
3 bar	65°C	15°C	65	63	57	50	44	40
	85°C	15°C	85	83	74	64	56	50